

EC2500 – 2 Cabs Elevator Control Board

For complete instructions, refer to the Technical Guide.

Do not store this document inside the ACU enclosure unless the document is wholly contained within a fire-retardant envelop or tube.


NEW – The control board may require setting S2 DIP switches. Refer to the Specifications / Settings sheet.

DPS-15 Power Supply

Dual linear DC outputs:

- ACU output 12 VDC @ 1.2 Amperes
- AUX/RDR output 12 VDC @ 1.2 Amperes

The total current draw on each output should not exceed 1 Amp with 200 mA in reserve for accommodating peak current operating demands.

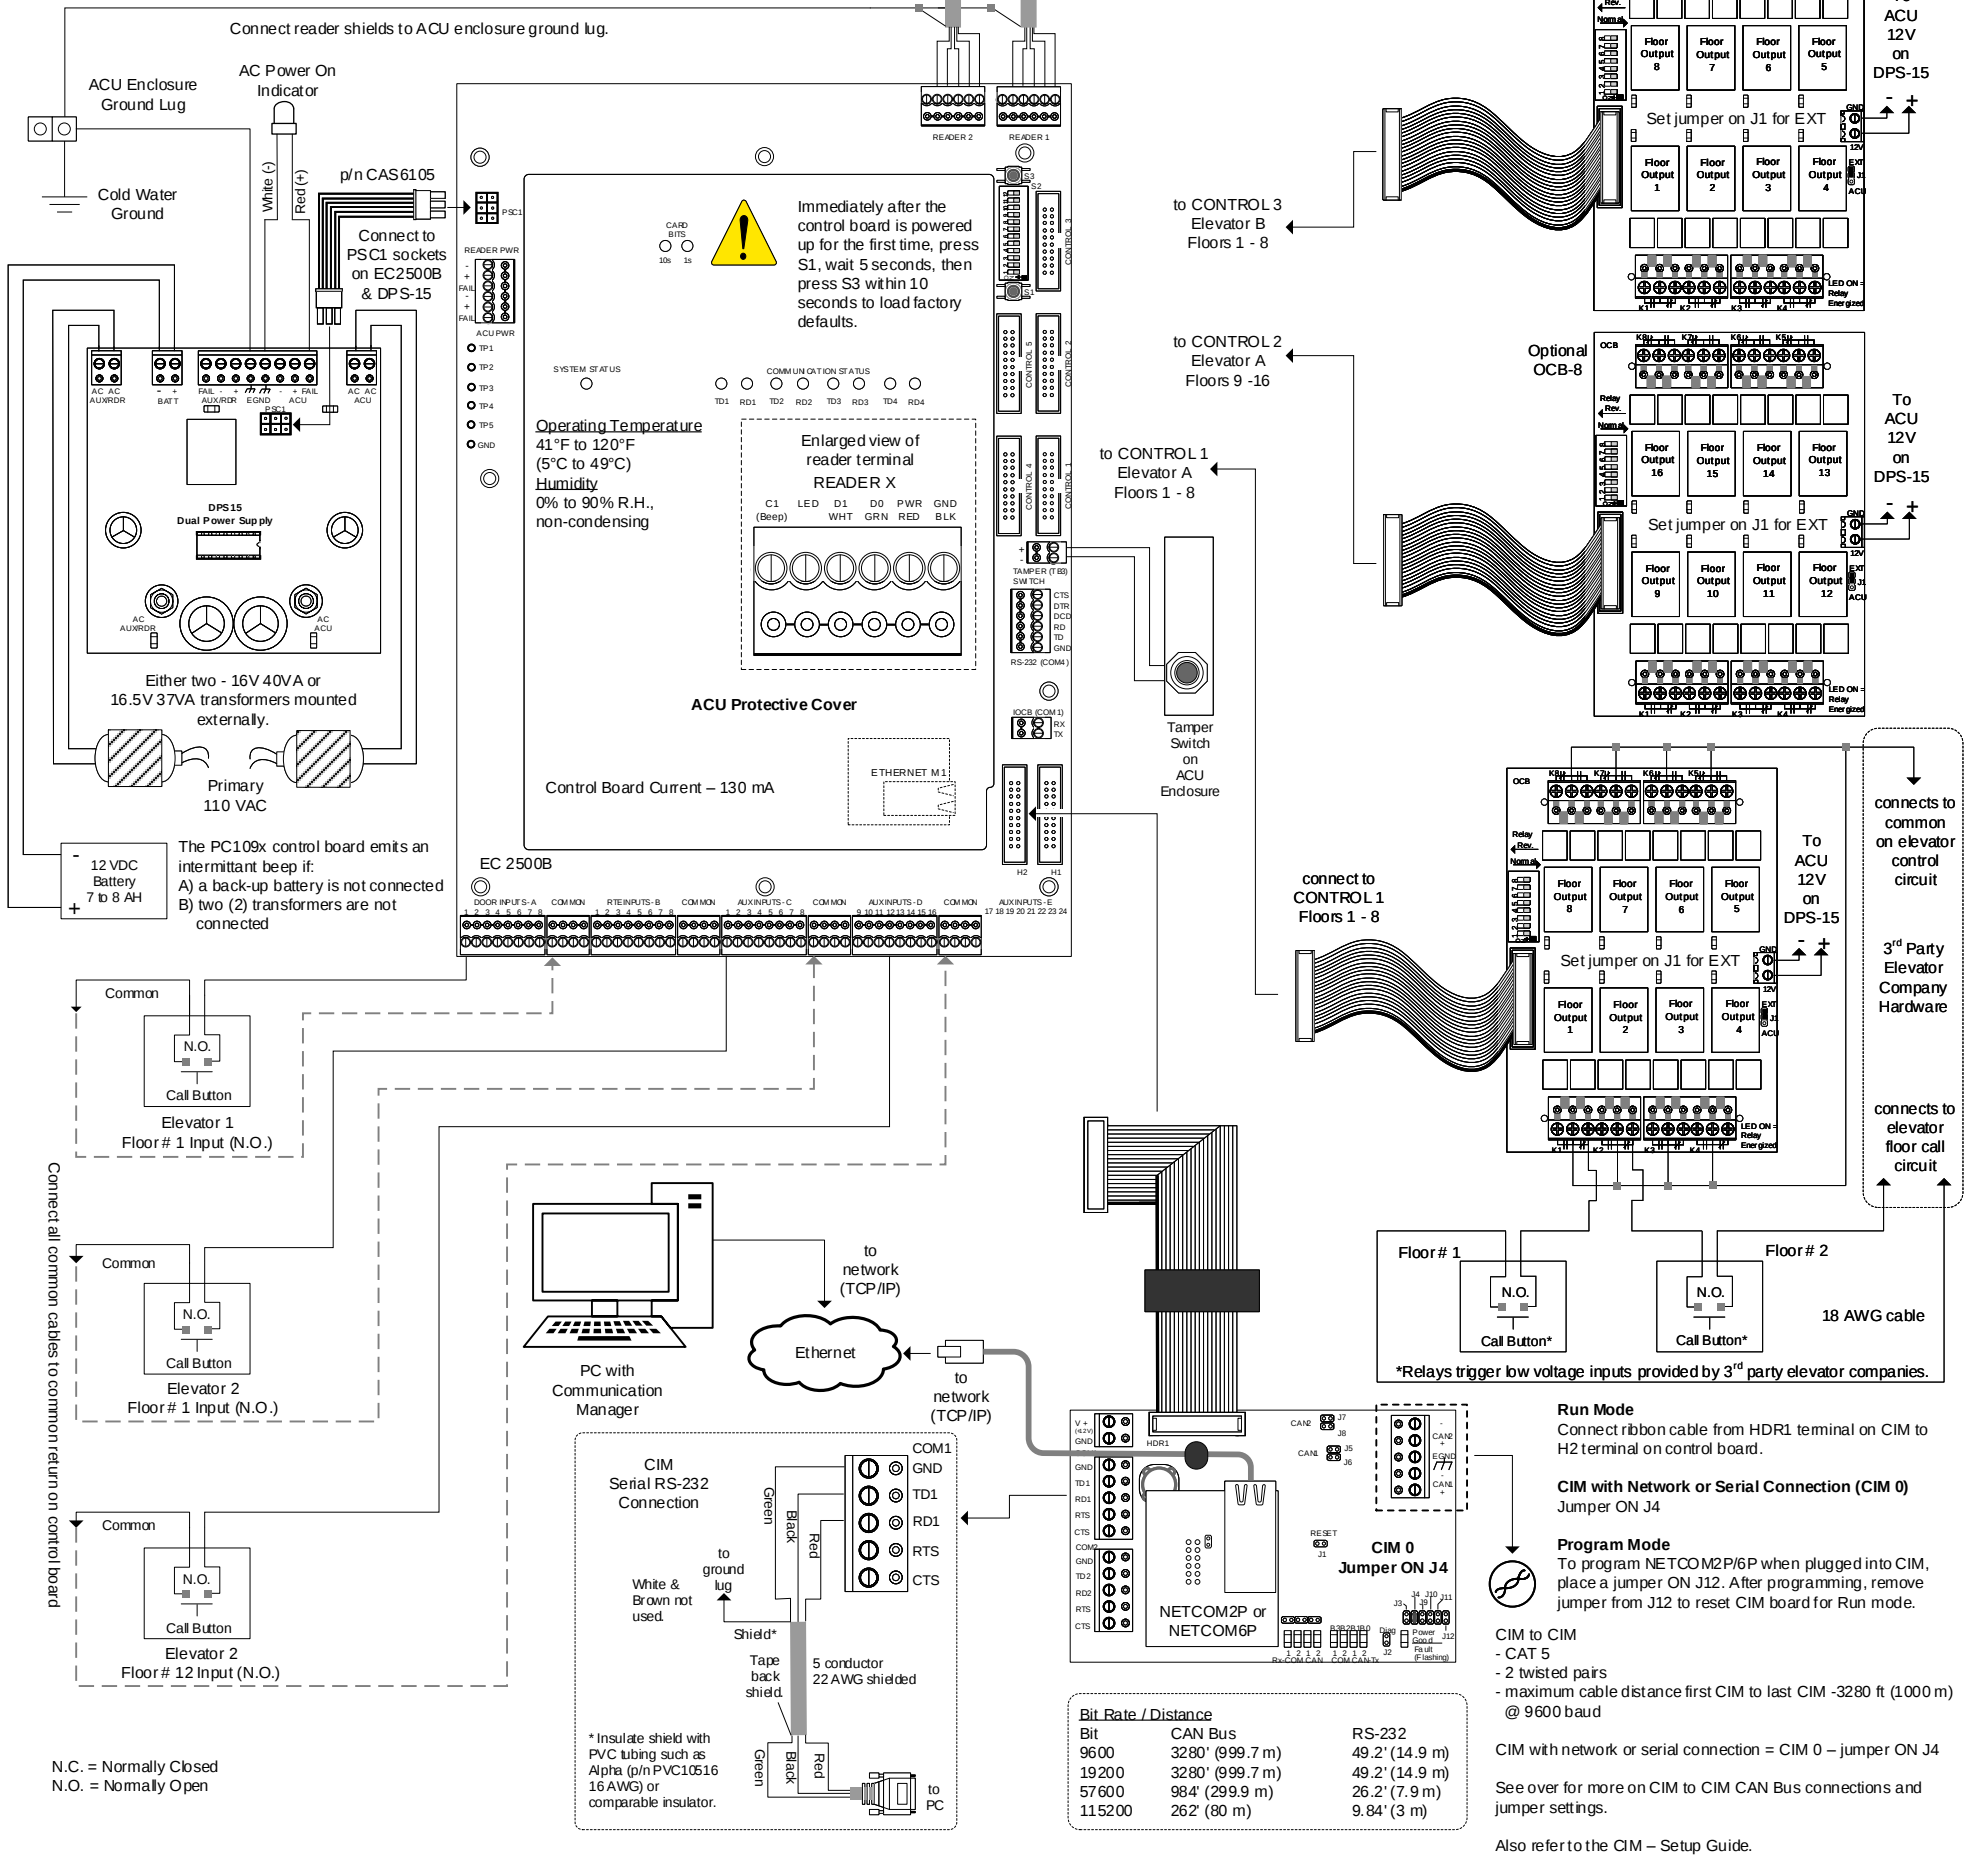


EC2500 Control Board – Serial # _____ (Communication address) / NETCOM Device – IP Address _____ Subnet Mask _____


Floor Names

Floor # 1	Floor # 2	Floor # 3
Floor # 4	Floor # 5	Floor # 6
Floor # 7	Floor # 8	Floor # 9
Floor # 10	Floor # 11	Floor # 12
Floor # 13	Floor # 14	Floor # 15
Floor # 16		


Circuit Board Mounting Locations

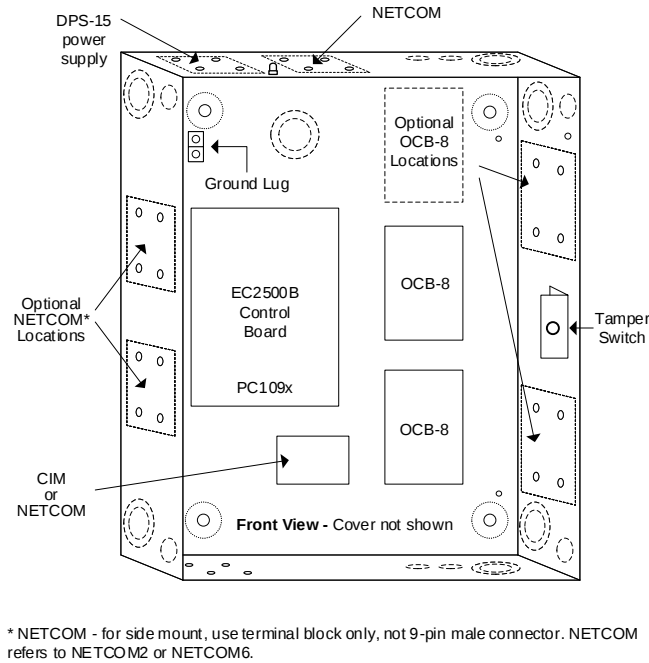


Communication – Network (TCP/IP)

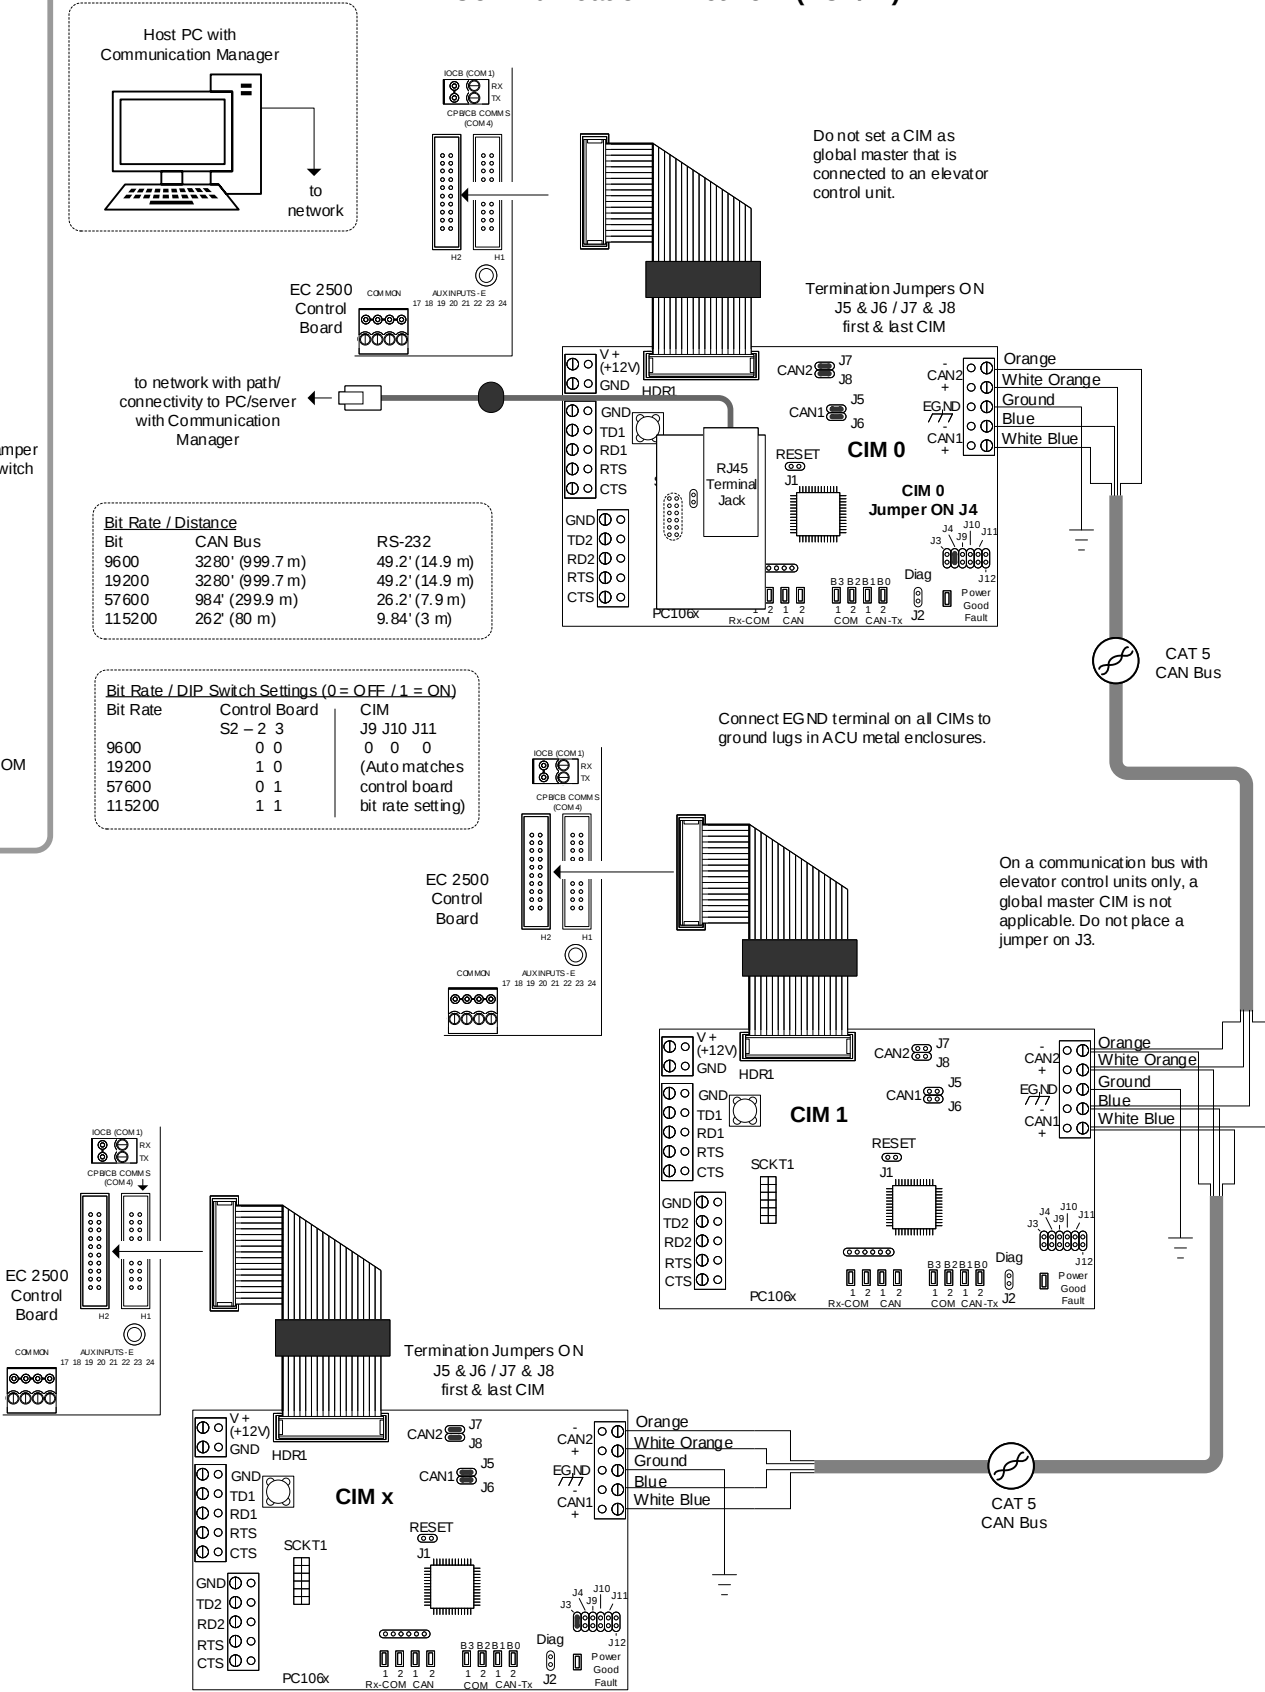

USB-SER Adaptor - RS-232 Connection

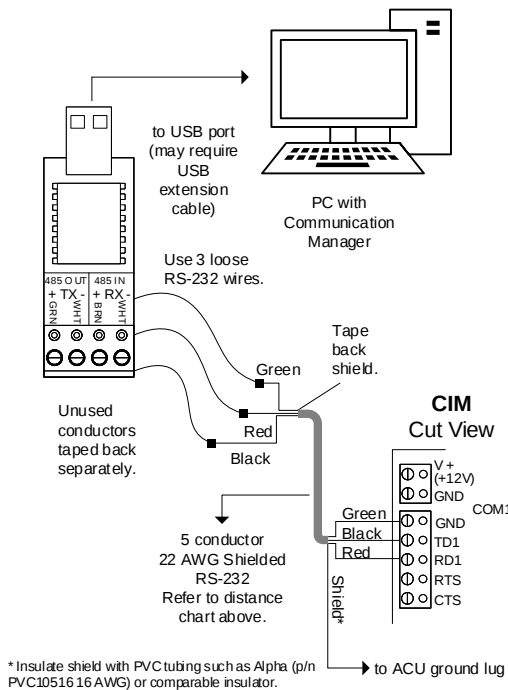

Reader Termination

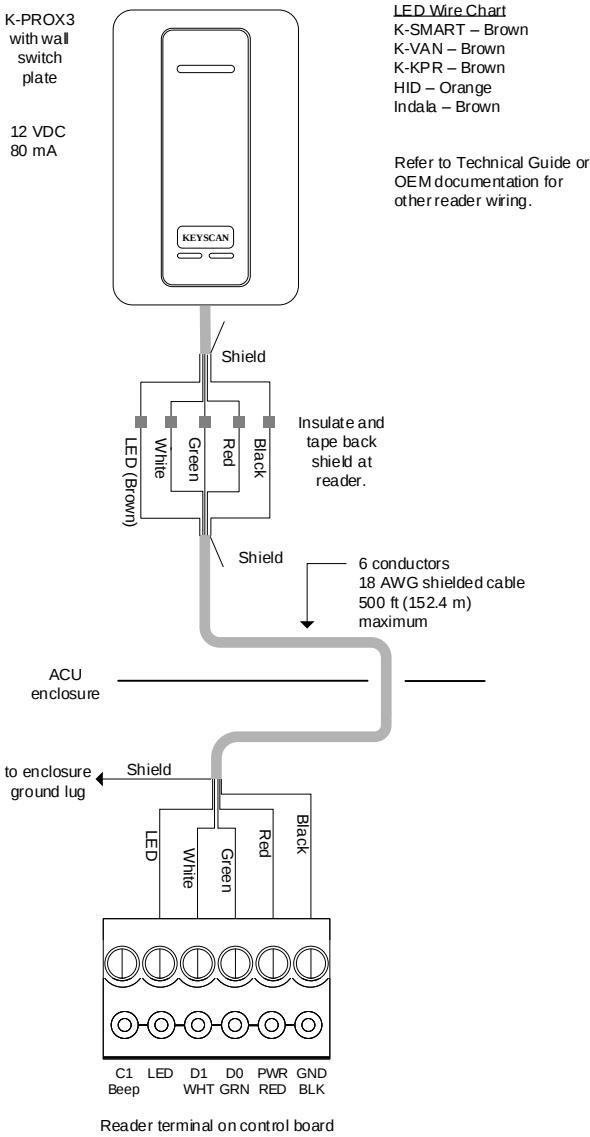

Terminate Floor Wiring at OCB-8

